Frequency management barometer

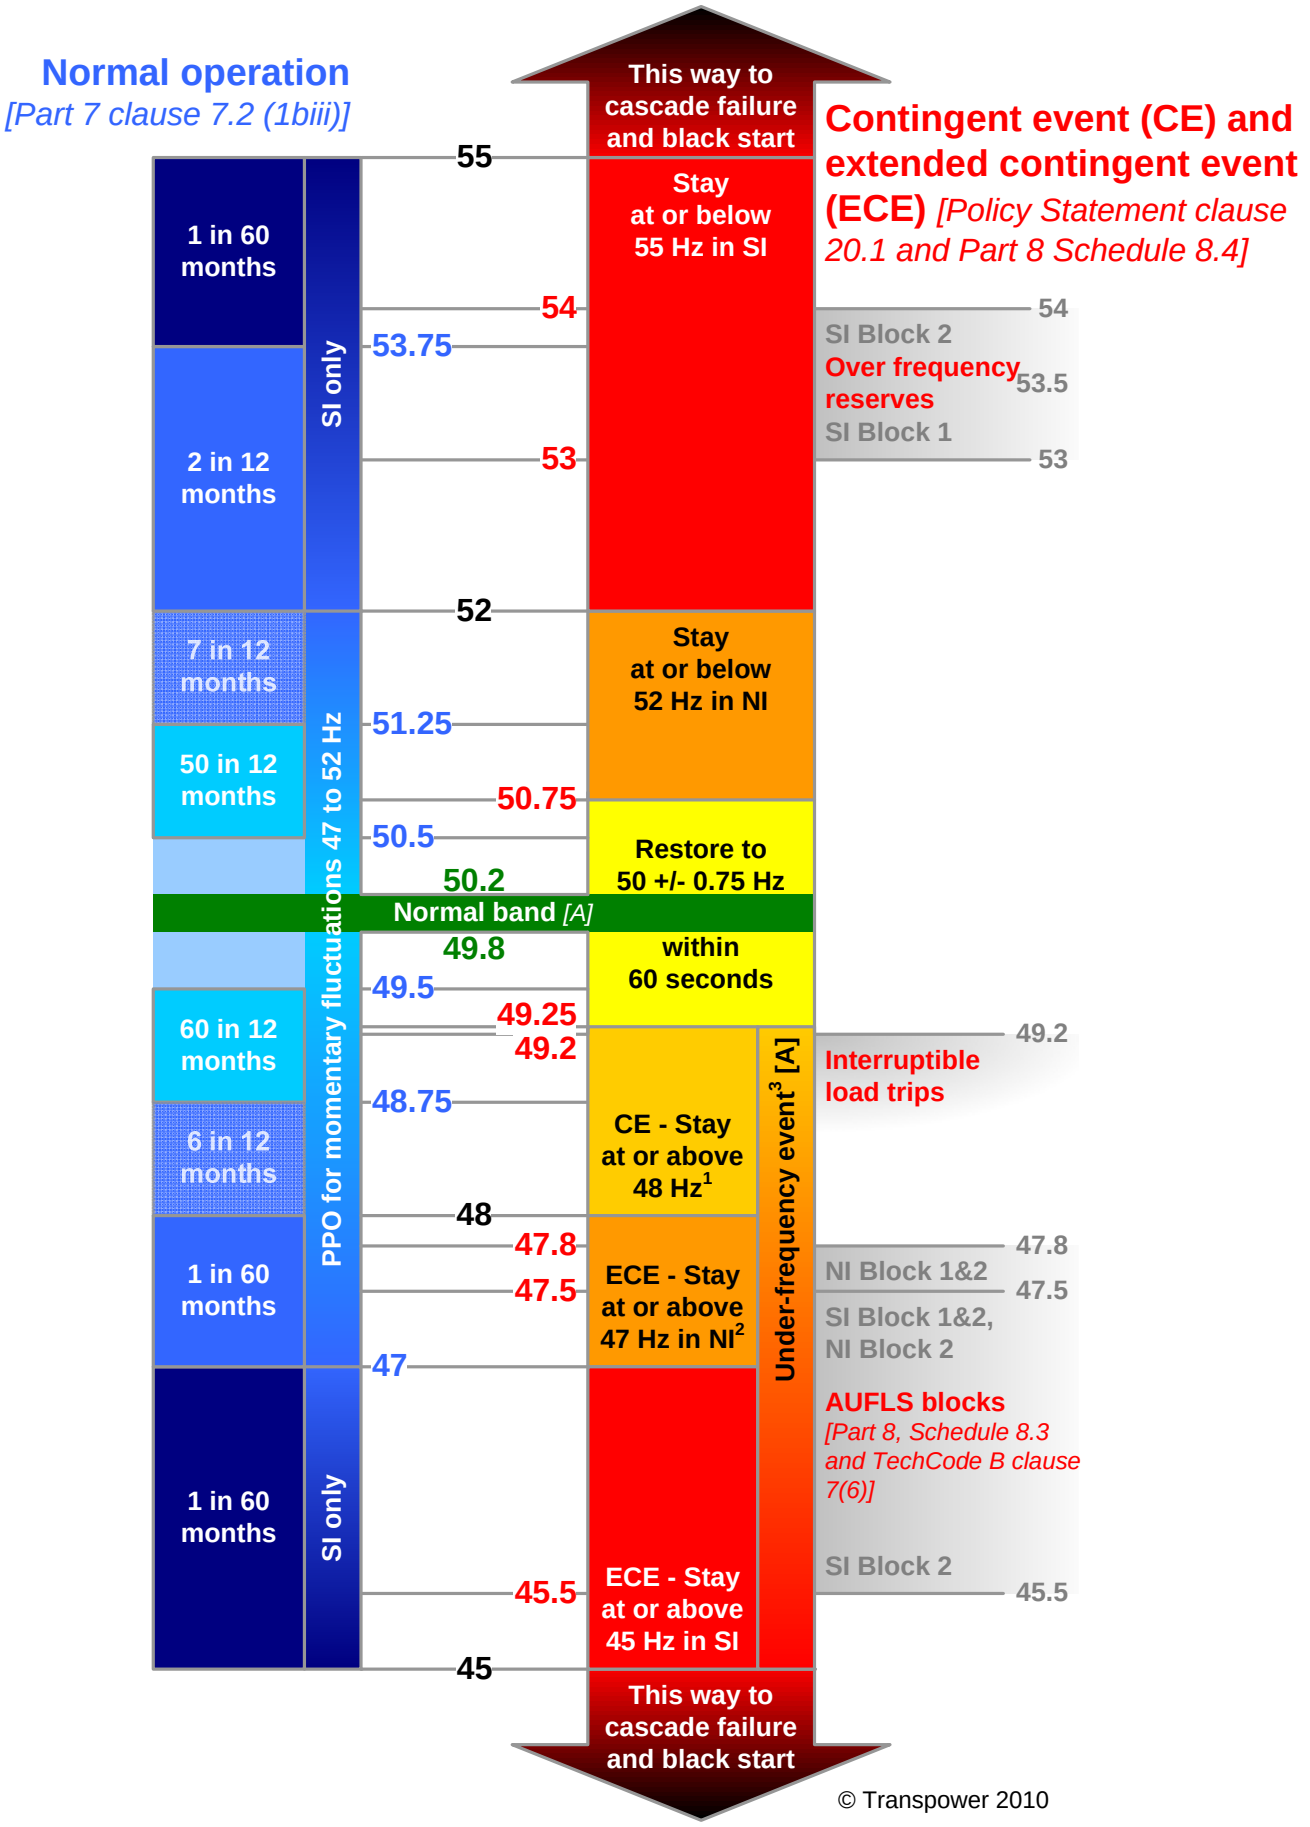

© Transpower 2010

1 *Where there is a shortage of instantaneous reserve for a contingent event the SO will rely on the operation of AUFLS schemes or un-dispatched HVDC response, i.e. frequency can drop below 48 Hz [Policy Statement clauses 67, 68]*
2 *With limited time below 47.3 Hz*
3 *If lost generation > 60 MW over 60 seconds*
[ ] *The 'Code clause reference* NI = North Island, SI = South Island